



CURBSIDE SIDEWALK

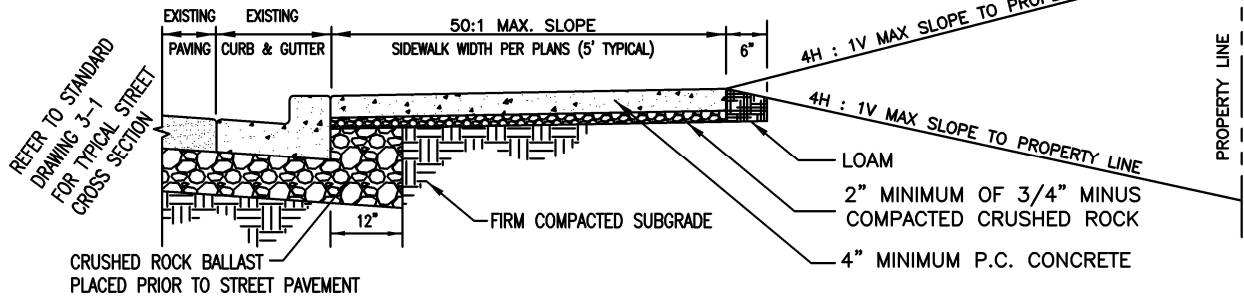


SETBACK SIDEWALK

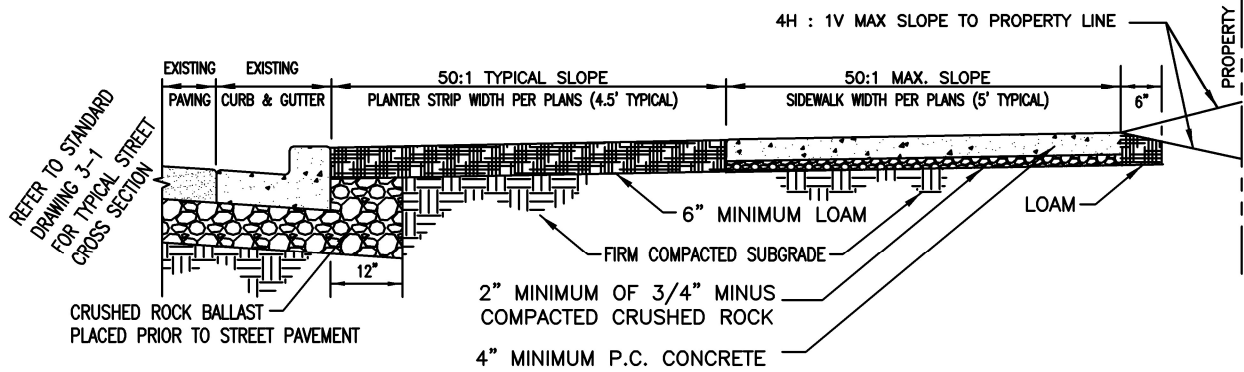

NOTES

- NO ABOVE-GROUND FACILITIES (FIRE HYDRANTS, POWER POLES, CATCH BASINS, VALVES, J-BOXES, ETC.) SHALL BE PERMITTED WITHIN THE SIDEWALK AREA
- ALL SURFACES SHALL HAVE A BROOM FINISH.
- SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3000 PSI FIELD STRENGTH (3450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE
- CURBS & COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE

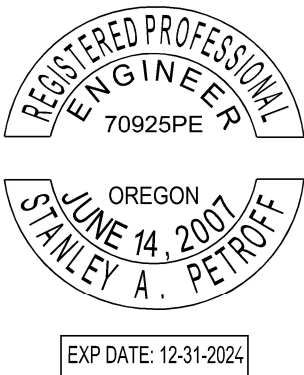

SIDEWALK CONSTRUCTION

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 2-1			
2	DRAWING UPDATE	4/2024	JG	

STANDARD
DRAWING
3-12
2024