



# STANDARD CURB & GUTTER

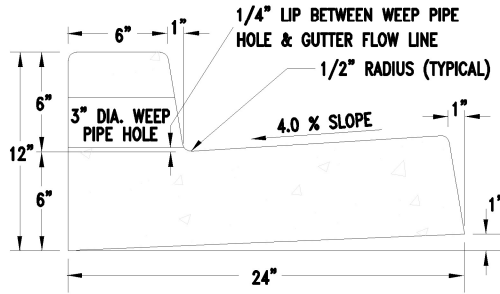


## EXTRUDED CURB

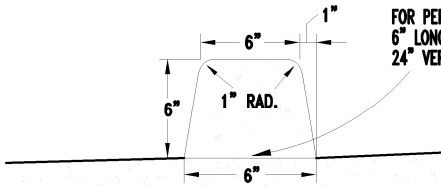


FOR PERMENT INSTALLATION - ADD  
6" LONG #4 DEFORMED BAR EVERY  
24" VERTICALLY

## FULL DEPTH CURB

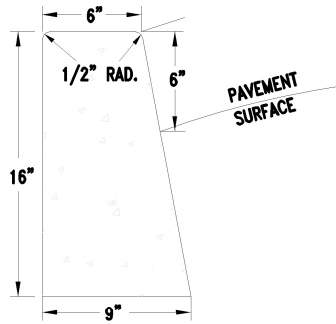


WEEP HOLES SHALL BE PLACED AT 75' O.C. OR AS OTHERWISE SPECIFIED;  
REFER TO STD DWG. 3-6 FOR INSTALLATION DETAILS. IN NEW  
CONSTRUCTION, PLACE CONTRACTION JOINT OVER & IN FRONT OF PIPE

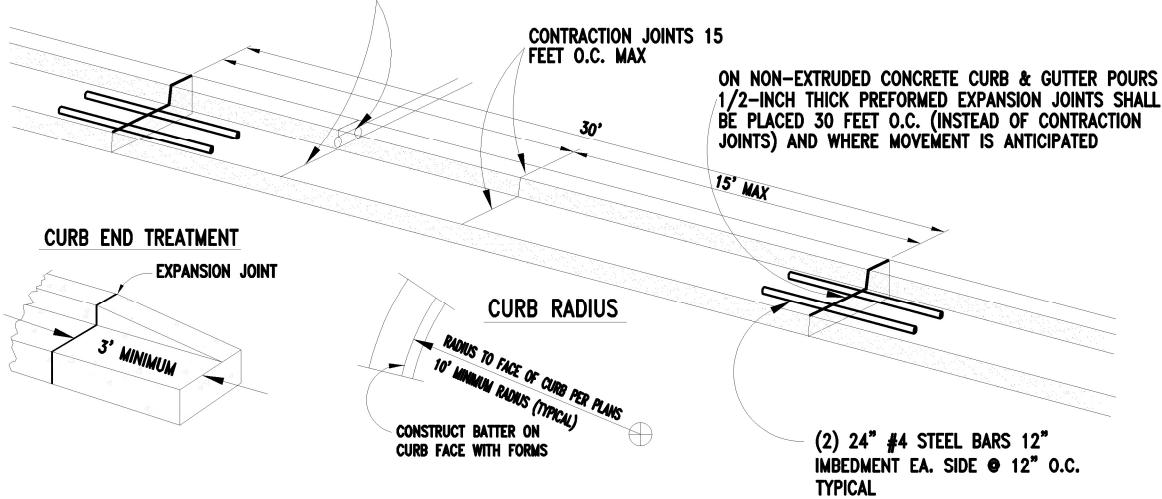

## NOTES

- WHERE CONCRETE PAVEMENT WILL BE USED, CONTRACTION JOINTS SHALL BE PLACED TO MATCH TRANSVERSE CONTRACTION JOINT LOCATIONS IN STREET PAVEMENT AND 24" #4 REBAR TIE BARS SHALL BE PLACED IN GREEN CONCRETE.
- CURB AND GUTTER SURFACES SHALL HAVE A BROOM FINISH PARALLEL TO THE LENGTH OF THE CURB.
- SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3,000 PSI FIELD STRENGTH (3,450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE.
- CURBS AND COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4,025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE.

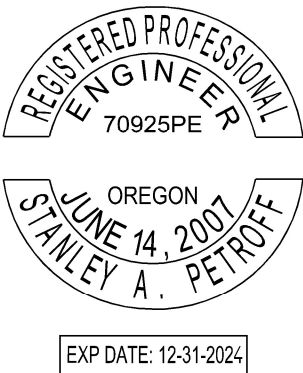

## CURB & GUTTER

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 2-1			
2	DRAWING UPDATE	09/2022	TG	
3	DRAWING UPDATE	04/2024	JG	

STANDARD  
DRAWING  
**3-5**  
2024