

#4 REBAR (HOOP)  
42" HOOP @ 6"  
O.C. 3" MIN  
COVER TOP &  
BOTTOM

INLAND FOUNDRY CO. INC.  
OR EQUAL  
RING .....NO.802  
COVER .....NO. 802-2



SLEEVE (SEE NOTE)  
USE POLYMER SEALANT  
AT CONE & FRAME

ALL CONSTRUCTION JOINTS  
SHALL BE MORTARED WITH  
NON-SHRINK GROUT

CAST-IN-PLACE BOOT  
OR N-SEAL OR  
APPROVED EQUAL

NOTES:

1. ALL PIPE CONNECTIONS TO MANHOLES SHALL BE CORE DRILLED UP TO 12".
2. ALL PIPE CONNECTIONS GREATER THAN 12" SHALL BE CONNECTED AS DIRECTED BY (CITY) ENGINEER IN THE FIELD, OR, BY STAMPED DRAWING APPROVED BY THE CITY ENGINEER.
3. SLEEVE: USE APPROVED POLYMER SEALANT MATERIAL. PREFERRED 27" PVC, HDPE OR OTHER AS APPROVED BY ENGINEER.
4. SEE STD DWG 4-1A FOR FRAME ADJUSTMENT DETAIL.

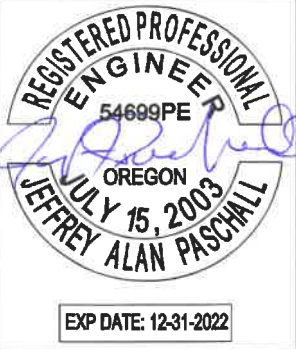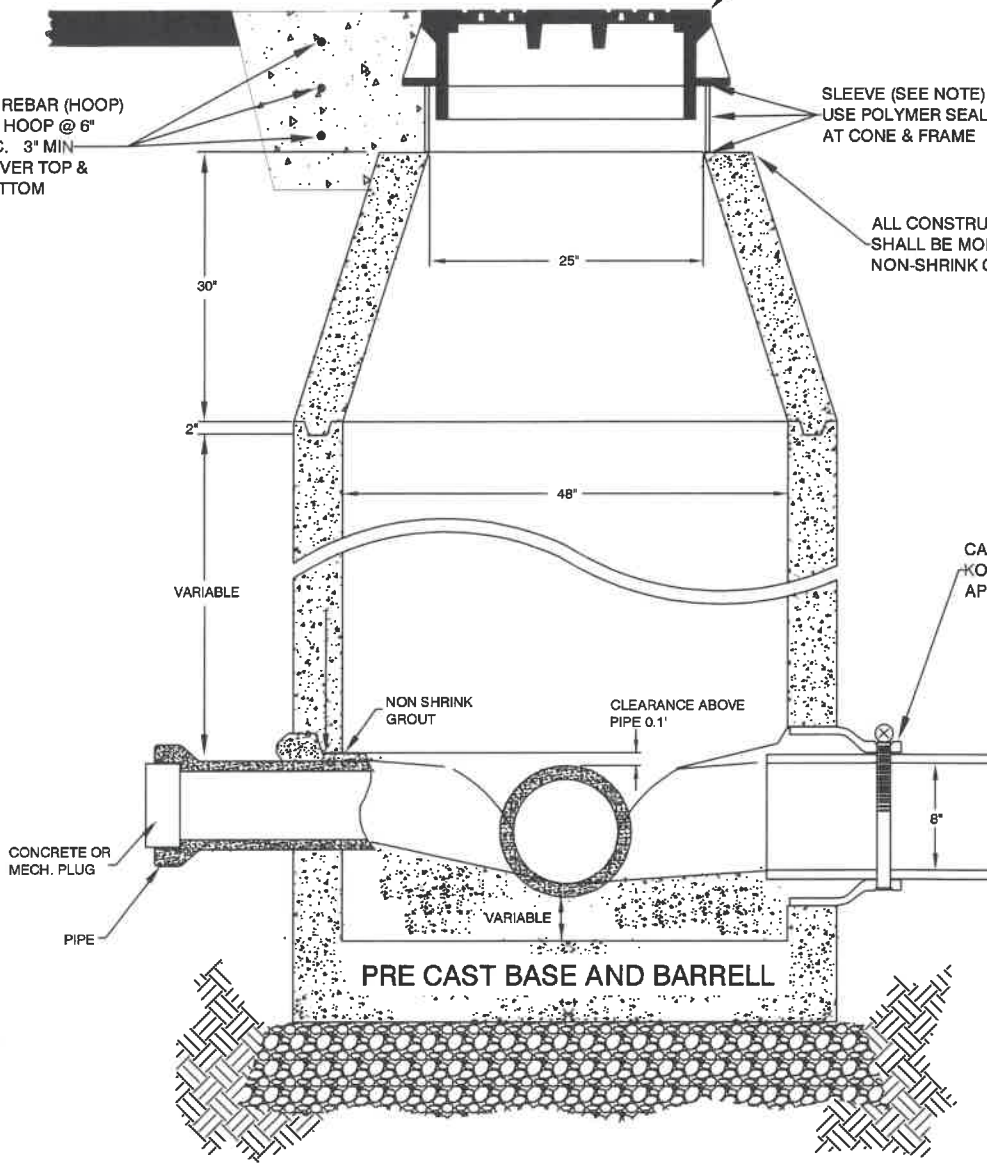

# STANDARD MANHOLE

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 4-1	01/2022	BJ	

STANDARD  
DRAWING  
**4-1**  
2022