




STANDARD CURB & GUTTER

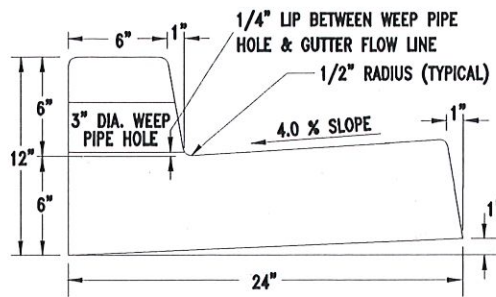


EXTRUDED CURB

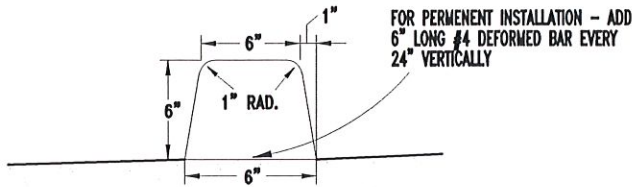


FULL DEPTH CURB

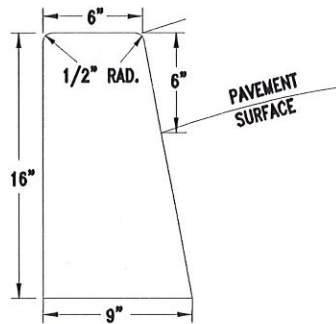


WEEP HOLES SHALL BE PLACED AT 75' O.C. OR AS OTHERWISE SPECIFIED; REFER TO STD DWG. 3-6 FOR INSTALLATION DETAILS. IN NEW CONSTRUCTION, PLACE CONTRACTION JOINT OVER & IN FRONT OF PIPE

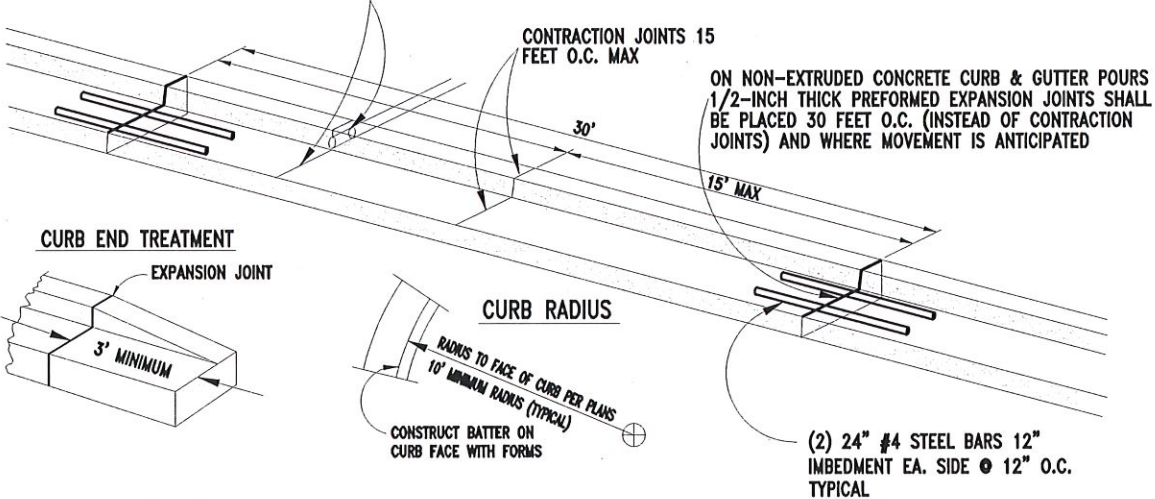

CURB END TREATMENT



CURB RADIUS



NOTES

- WHERE CONCRETE PAVEMENT WILL BE USED, CONTRACTION JOINTS SHALL BE PLACED TO MATCH TRANSVERSE CONTRACTION JOINT LOCATIONS IN STREET PAVEMENT AND 24" #4 REBAR TIE BARS SHALL BE PLACED IN GREEN CONCRETE.
- CURB AND GUTTER SURFACES SHALL HAVE A BROOM FINISH PARALLEL TO THE LENGTH OF THE CURB.
- SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3,000 PSI FIELD STRENGTH (3,450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE.
- CURBS AND COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4,025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE.



EXP DATE: 12-31-2022



CURB & GUTTER

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 2-1			
2	DRAWING UPDATE	09/2022	TG	

STANDARD
DRAWING
3-5
2022