CONTRACTION JOINTS-WIDTH MATCH SIDEWALK WIDTH (5' ON CENTER TYPICAL)

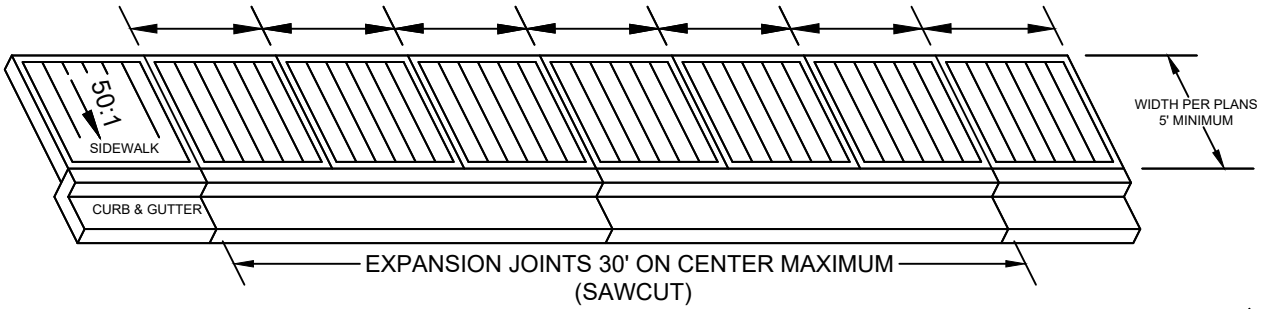

CURBSIDE SIDEWALK

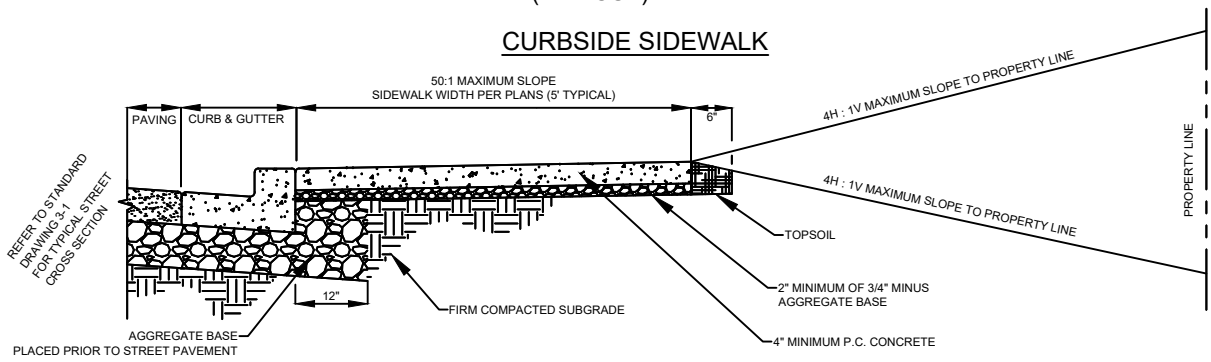

SETBACK SIDEWALK

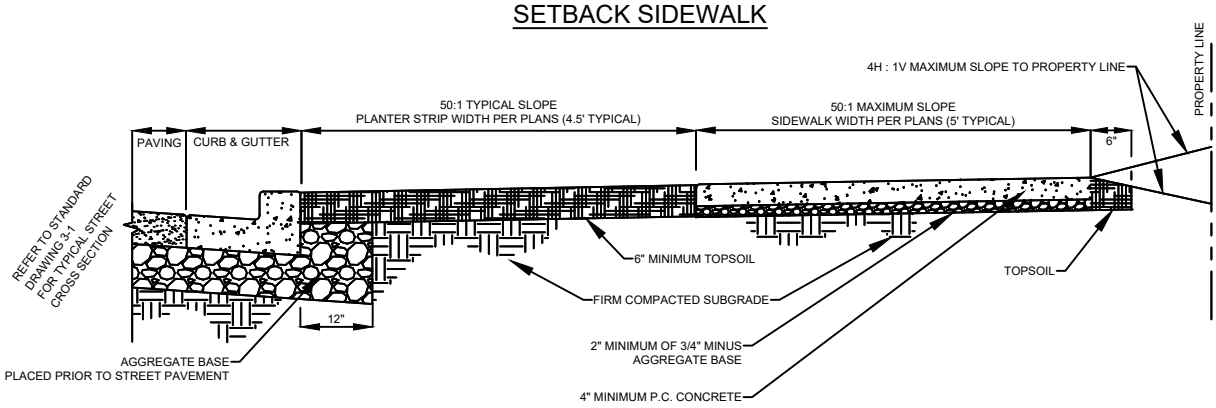

NOTES

- NO ABOVE-GROUND FACILITIES (FIRE HYDRANTS, POWER POLES, CATCH BASINS, VALVES, J-BOXES, ETC.) SHALL BE PERMITTED WITHIN THE SIDEWALK AREA
- ALL SURFACES SHALL HAVE A BROOM FINISH.
- SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3000 PSI FIELD STRENGTH (3450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE
- CURBS & COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI FIELD STRENGTH (4025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE

REGISTERED PROFESSIONAL ENGINEER
70925PE
Stanley A Petroff
Digitally signed by Stanley A Petroff
Date: 2025.05.29 10:01:29-07'00'
OREGON
JUNE 14, 2007
STANLEY A. PETROFF
EXP DATE: 12-31-2026

SPRINGFIELD OREGON

SIDEWALK

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 3-12			
2	DRAWING UPDATE	4/2024	JG	
3	STAMP UPDATE	2/2025	TG	
4	DRAWING UPDATE	5/2025	JG	

STANDARD DRAWING
3-12
2025