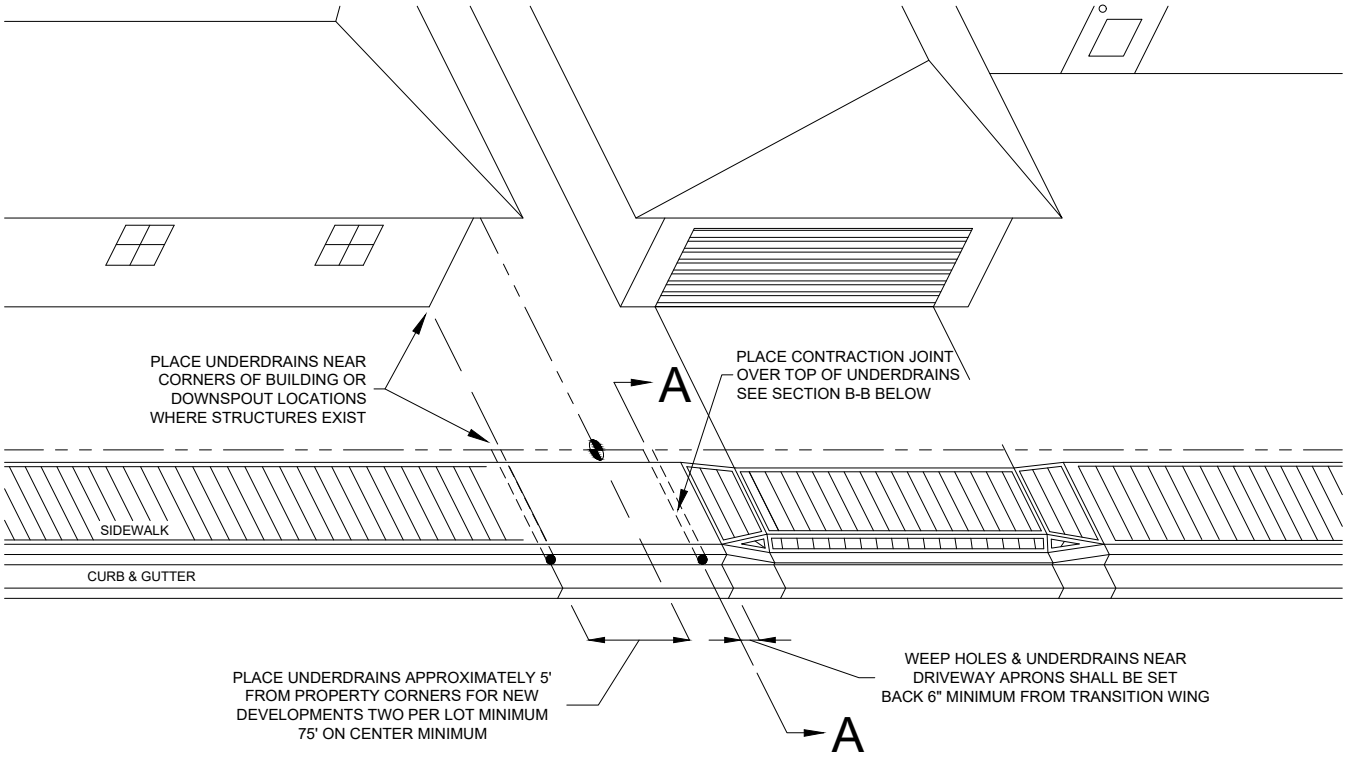

SECTION A - A

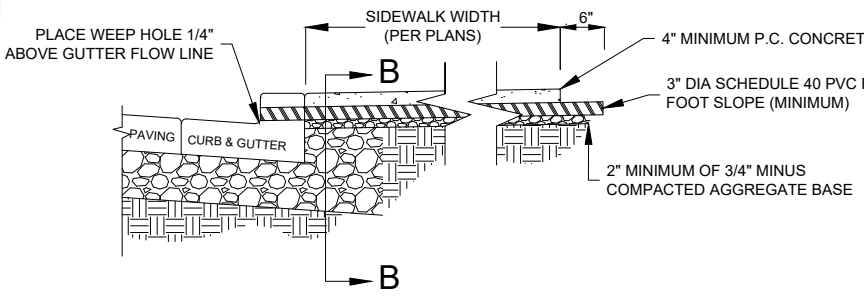

SECTION B - B

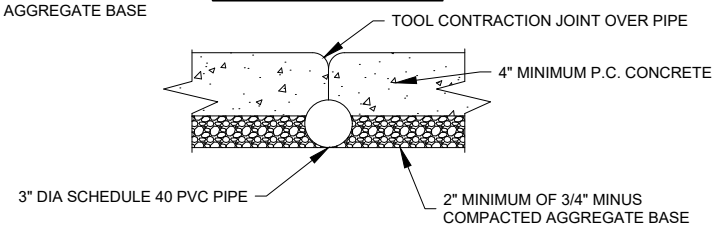

NOTES

- CONNECTIONS BEHIND THE PROPERTY LINE MAY REQUIRE A PLUMBING PERMIT FROM THE BUILDING DEPARTMENT
- UNDERDRAINS SHALL BE 3" SCHEDULE 40 PVC PIPE.
- SIDEWALKS, ACCESS RAMPS, AND RESIDENTIAL DRIVEWAYS SHALL BE 3000 PSI MINIMUM FIELD STRENGTH (3450 PSI LAB STRENGTH) 6.0 SACK MIX CONCRETE
- CURBS & COMMERCIAL DRIVEWAYS SHALL BE 3500 PSI MINIMUM FIELD STRENGTH (4025 PSI LAB STRENGTH) 6.3 SACK MIX CONCRETE

REGISTERED PROFESSIONAL ENGINEER
70925PE
Stanley A Petroff
Digitally signed by Stanley A Petroff
Date: 2025.05.29 09:53:21 -07'00'
OREGON
JUNE 14, 2007
STANLEY A. PETROFF

EXP DATE: 12-31-2026

SPRINGFIELD OREGON

UNDER DRAIN INSTALLATION

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 3-6			
2	DRAWING UPDATE	10/2019	CR	
3	DRAWING UPDATE	02/2021	TG	
4	DRAWING UPDATE	04/2024	JG	
5	DRAWING UPDATE	05/2025	JG	

STANDARD DRAWING
3-6
2025