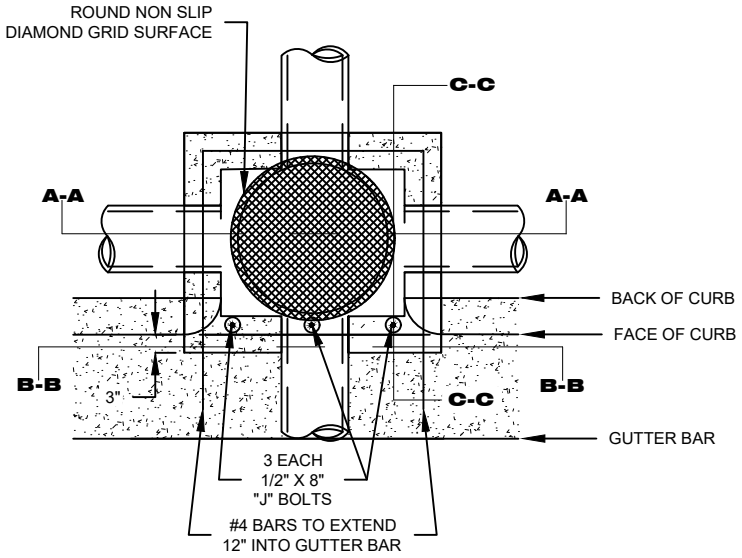

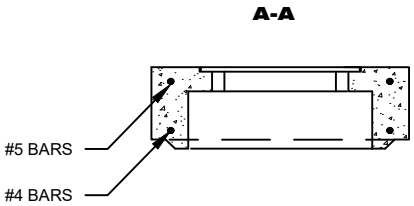

NOTE:

1. ALL CONCRETE SHALL BE A MIN. 3500 PSI COMPRESSIVE FIELD STRENGTH AT 28 DAYS.
2. A ROUND ODOT TYPE MAINTENANCE LID MAY BE USED OR SUBSTITUTED WITH AN APPROVAL FROM THE CITY ENGINEER.
3. BASE MAY BE PRECAST OR CAST IN PLACE.

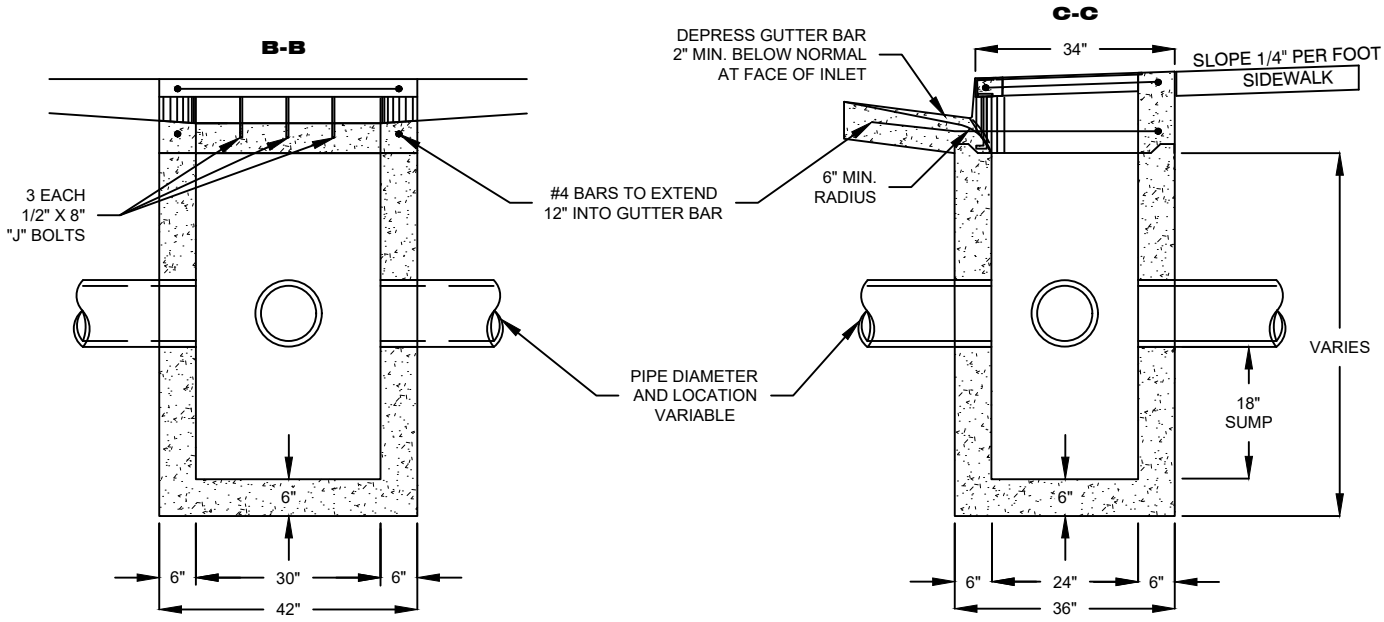

REGISTERED PROFESSIONAL ENGINEER
70925PE
Stanley A Petroff
Digitally signed by Stanley A Petroff
Date: 2025.09.04 09:23:43-07'00'
OREGON
JUNE 14, 2007
STANLEY A. PETROFF

EXP DATE: 12-31-2026

SPRINGFIELD OREGON

CURB INLET CATCH BASIN TYPE 2 1/2A

NO	REVISION	DATE	BY	APPR.
1	CITY DWG. 4-9			
2	DRAWING UPDATE	08/2025	JG	

STANDARD DRAWING
4-9
2025