SANITARY TAP
INSERTA-TEE TYPE

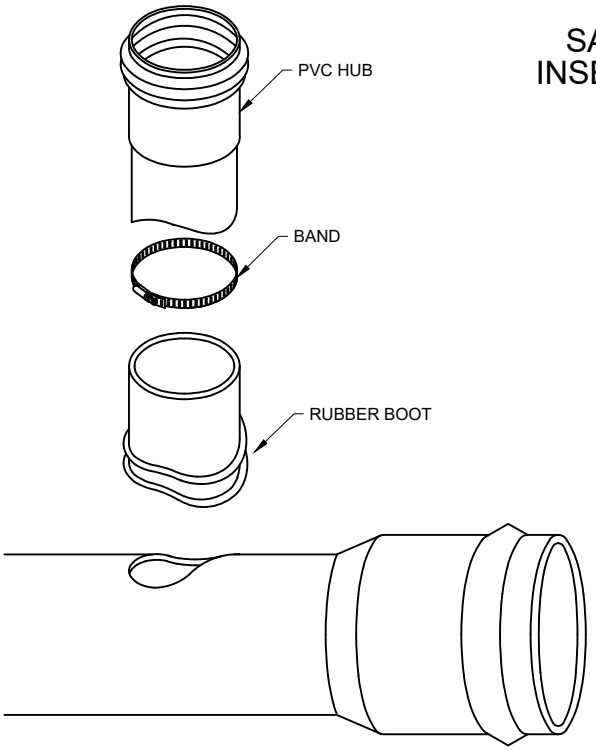

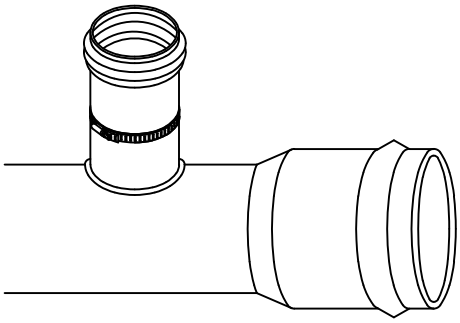

NOTE:
REQUIRED
1. PIPE SHALL BE CORE-DRILLED
2. PLUG SHALL BE RETRIEVED

FOWLER - TYPE TEE
OR EQUAL

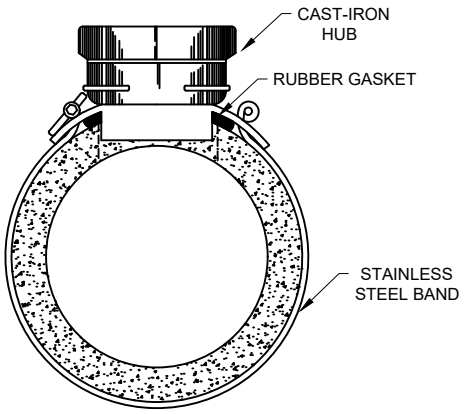

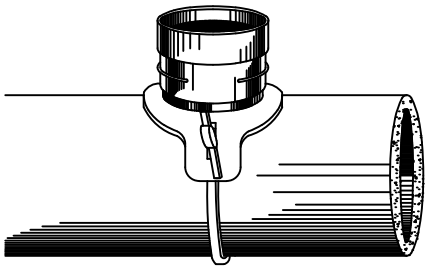

REGISTERED PROFESSIONAL ENGINEER
70925PE
Stanley A Petroff
Digitally signed by Stanley A Petroff
Date: 2025.11.06 10:27:17-08'00'
OREGON
JUNE 14, 2007
STANLEY A. PETROFF

EXP DATE: 12-31-2026

SPRINGFIELD OREGON

TYPICAL PIPE CONNECTIONS

NO	REVISION	DATE	BY	APPR.
1	DRAWING UPDATE	06/2008	JP	
2	DRAWING UPDATE	04/2024	TG	
3	DRAWING UPDATE	10/2025	JG	

STANDARD DRAWING
4-7
2025